

NOTICE TO THE PUBLIC OF AN APPLICATION BY
EXPEDITION GENERATING I, LLC AND
EXPEDITION GENERATING II, LLC
FOR CERTIFICATES OF PUBLIC CONVENIENCE
AND NECESSITY TO CONSTRUCT AND OPERATE
A NATURAL GAS-FIRED ELECTRIC GENERATING
FACILITY AND ASSOCIATED FACILITIES IN
FLUVANNA COUNTY, VIRGINIA
CASE NO. PUR-2026-00102

On July 15, 2026, Expedition Generating I, LLC and Expedition Generating II, LLC (“Expedition” or the “Applicants”) filed with the State Corporation Commission (“Commission”) an application (“Application”) for certificates of public convenience and necessity (CPCNs) to construct and operate the following facilities:

(1) A natural gas-fired, combined-cycle electric generating facility with a nominal summer capacity of up to 1,540 megawatts (“MW”) in Fluvanna County, Virginia, and associated facilities (“Expedition Generating Station” or the “Facility”); and

(2) An approximately 1.8-mile, 500 kilovolt (“kV”) generation-tie line (“Gen- Tie Line”) extending from the Expedition Generating Station to the point of interconnection at the existing 500 kV Cunningham Substation owned by Virginia Electric and Power Company (“Dominion”).

Collectively, the Expedition Generating Station and the Gen-Tie Line are referred to as the “Project.”

According to the Application, the Project is needed to address critical reliability concerns, and without it, there would be fewer options to meet rapidly growing electricity demand. The Applicants state that the Project was selected as part of PJM Interconnection, LLC’s Reliability Resource Initiative, which is a one-time process designed to accelerate the interconnection review of generation resources that can come online quickly and make meaningful contributions to reliability. The Application further asserts that the Project would increase system reliability by adding over a gigawatt of new capacity that would increase reliability to local and regional systems, and would lower capacity prices by closing the gap in the resource adequacy shortfall.

The Applicants state that the Expedition Generating Station would be a natural gas-fired electric generating facility with

nominal summer capacity of up to 1,540 MW, and would consist of two natural gas-fired combustion turbine generators (furnished with low nitrogen oxide burners), two heat recovery steam generators (equipped with selective catalytic reduction systems), and two steam turbine generators. The Facility is expected to have a peak natural gas consumption of approximately 9,000 to 12,000 MMBtu (million British thermal units) per hour, inclusive of duct firing conditions. According to the Application, the Expedition Generating Station would be located on two parcels that total approximately 426 acres, which are adjacent to the Tenaska Virginia Partners Generating Station, in close proximity to existing transmission infrastructure and traversed by an existing interstate natural gas pipeline. The Expedition Generating Station would interconnect to this existing infrastructure to obtain fuel and deliver electricity directly into the interstate transmission system. According to the Application, the Expedition Generating Station would receive pipeline-quality natural gas from Transcontinental Gas Pipeline Company (“Transco”) by a short, less than one-half-mile-long new natural gas lateral pipeline connecting the facility to the Transco system.

The Applicants state that to interconnect the Project with the interstate transmission system and transmit power from the Expedition Generating Station’s 500 kV switchyard to Dominion’s existing 500 kV Cunningham Substation, an approximately 1.8-mile, 500 kV Gen-Tie Line would be constructed entirely in Fluvanna County, Virginia. The proposed route of the Gen-Tie Line is in a predominantly rural and forested area and is located on land that is owned or controlled by the Applicants or one of their affiliates.

According to the Application, the total capitalized investment for the Expedition Generating Station is estimated to be \$2.4 billion, consisting of approximately \$950 million in equipment and procurement expenses and approximately \$1.4 billion in construction and development costs (2026 dollars). Further, the Applicants state that the estimated transmission-related costs for the Gen-Tie Line are approximately \$74.5 million.

Expedition asserts that the Project will have minimal adverse environmental impacts and is consistent with the environmental justice goals set forth in the Virginia Environmental Justice Act, § 2.2-234 *et seq.* of the Code of Virginia. Further, the Applicants estimate that the Project would generate approximately \$247.7 million in tax revenue to Fluvanna County over its expected 30-year life.

Description of Route for the Proposed Project

Structure heights are expected to generally range from approximately 140 to 170 feet, with maximum heights not anticipated to exceed 180 feet under normal design conditions.

All distances, heights, and directions are approximate. A sketch map of the proposal accompanies this notice. A more detailed map may be viewed on the Commission's website: scc.virginia.gov/consumers/public-utility/electricity-faqs/transmission-line-projects. A more complete description of the Project also may be found in Expedition's Application.

The Commission may consider a route not significantly different from the route described in this notice without additional notice to the public.

The Commission entered an Order for Notice and Hearing in this proceeding that, among other things, scheduled a public hearing on Expedition's Application. On January 12, 2027, at 10 a.m., the Hearing Examiner assigned to this case will hold the telephonic portion of the hearing for the purpose of receiving the testimony of public witnesses. On or before January 6, 2027, any person desiring to offer testimony as a public witness shall provide required contact information to the Commission. This information may be provided to the Commission: (i) by filling out a form on the Commission's website at scc.virginia.gov/case-information/webcasting; or (ii) by calling (804) 371-9141. This public witness hearing will be webcast at scc.virginia.gov/case-information/webcasting.

On January 12, 2027, at 10 a.m., or at the conclusion of the public witness portion of the hearing, whichever is later, in the Commission's second floor courtroom located in the Tyler Building, 1300 East Main Street, Richmond, Virginia 23219, the Hearing Examiner will convene a hearing to receive testimony and evidence related to the Application from the Applicants, any respondents, and the Commission's Staff.

To promote administrative efficiency and timely service of filings upon participants, the Commission has directed the electronic filing of testimony and pleadings, unless they contain

confidential information, and has required electronic service on parties to this proceeding.

An electronic copy of the Application may be obtained by submitting a written request to counsel for the Applicants: Timothy E. Biller, Esquire or James G. Ritter, Esquire, Hunton Andrews Kurth LLP, 951 East Byrd Street, Richmond, Virginia 23219, or tbiller@hunton.com or ritterj@hunton.com. Interested persons also may download unofficial copies of the Application and other documents filed in this case from the Commission's website: scc.virginia.gov/case-information.

On or before January 6, 2027, any interested person may submit comments on the Application by following the instructions found on the Commission's website: scc.virginia.gov/case-information/submit-public-comments. Those unable, as a practical matter, to submit comments electronically may file such comments with the Clerk of the State Corporation Commission, c/o Document Control Center, P.O. Box 2118, Richmond, Virginia 23218-2118. All such comments shall refer to Case No. PUR-2026-00102.


On or before October 23, 2026, any person or entity wishing to participate as a respondent in this proceeding must do so by filing a notice of participation at scc.virginia.gov/clk/efiling. Those unable, as a practical matter, to file a notice of participation electronically may file such notice by U.S. mail to the Clerk of the Commission at the address listed above. Such notice of participation shall include the email addresses of such person or entity and their counsel. The respondent shall serve a copy of the notice of participation electronically on counsel to the Applicants, the Commission's Staff, and all other respondents. Pursuant to 5 VAC 5-20-80 B, *Participation as a respondent*, of the Commission's Rules of Practice and Procedure, 5 VAC 5-20-10 *et seq.* ("Rules of Practice"), any notice of participation shall set forth: (i) a precise statement of the interest of the respondent; (ii) a statement of the specific action sought to the extent then known; and (iii) the factual and legal basis for the action. Any notice of participation filed by a person not represented by counsel shall also set forth why the filer's positions in this matter are not adequately represented by another party to this proceeding and cannot be expressed through written or oral public comments as provided for in this proceeding. Any organization, corporation, or government body participating as a respondent must be represented by counsel

as required by 5 VAC 5-20-30, *Counsel*, of the Rules of Practice. All filings shall refer to Case No. PUR-2026-00102.


On or before October 30, 2026, each respondent may file with the Clerk of the Commission at scc.virginia.gov/clk/efiling any testimony and exhibits by which the respondent expects to establish its case. Any respondent unable, as a practical matter, to file testimony and exhibits electronically may file such by U.S. mail to the Clerk of the Commission at the address listed above. Each witness's testimony shall include a summary not to exceed one page. All testimony and exhibits shall be served electronically on the Commission's Staff, the Applicants, and all other respondents with their filing. In all filings, respondents shall comply with the Commission's Rules of Practice, as modified herein, including, but not limited to: 5 VAC 5-20-140, *Filing and service*, and 5 VAC 5-20-240, *Prepared testimony and exhibits*. All filings shall refer to Case No. PUR-2026-00102.

Any documents filed in paper form with the Office of the Clerk of the Commission in this docket may use both sides of the paper. In all other respects, except as modified by the Commission's Order for Notice and Hearing, all filings shall comply fully with the requirements of 5 VAC 5-20-150, *Copies and format*, of the Commission's Rules of Practice.

Expedition's Application and other documents filed in this case, the Commission's Rules of Practice, and the Commission's Order for Notice and Hearing may be viewed on the Commission's website at: scc.virginia.gov/case-information.

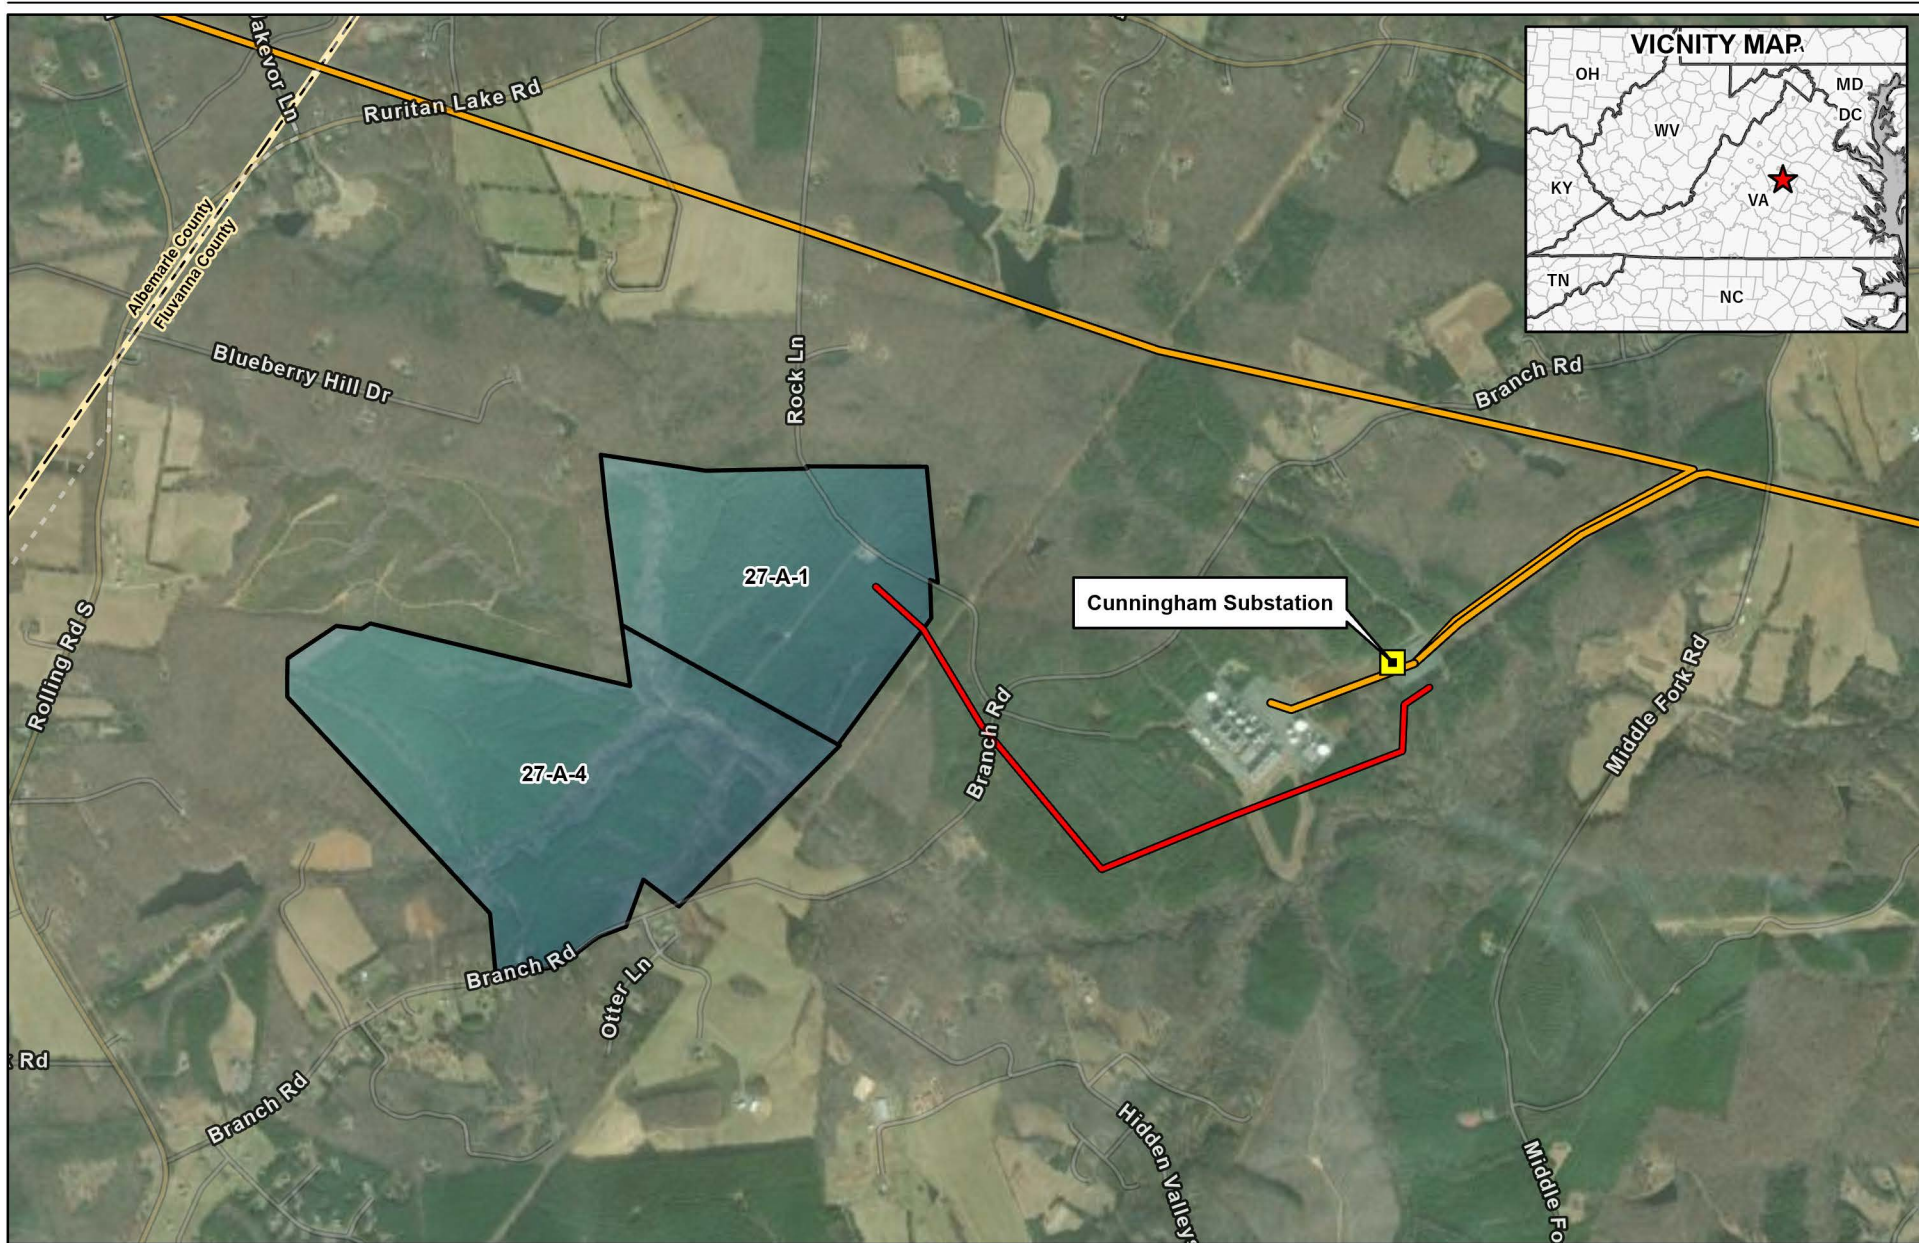

- Legend**
- Expedition Project Parcels
 - Expedition Gen-Tie Route
 - Cunningham Substation
 - 500kV Transmission Line
 - County Boundary



Notes: The 500-kV generator tie line routing shown is preliminary and subject to change based on final engineering and siting considerations. The alignment will remain within property owned or controlled by the Applicant. The centerline of the generator tie line is anticipated to be located a minimum of approximately 300 feet from existing residences.

Gen-Tie Map
Expedition Generating Station
Fluvanna County, Virginia

